


U-TYPE WINGWALL WITH BARRIER CURB	ISSUED: 2009	PLATE 3.4-3
--------------------------------------	--------------	----------------

PLATE
3.4-3

PLATE
3.4-3

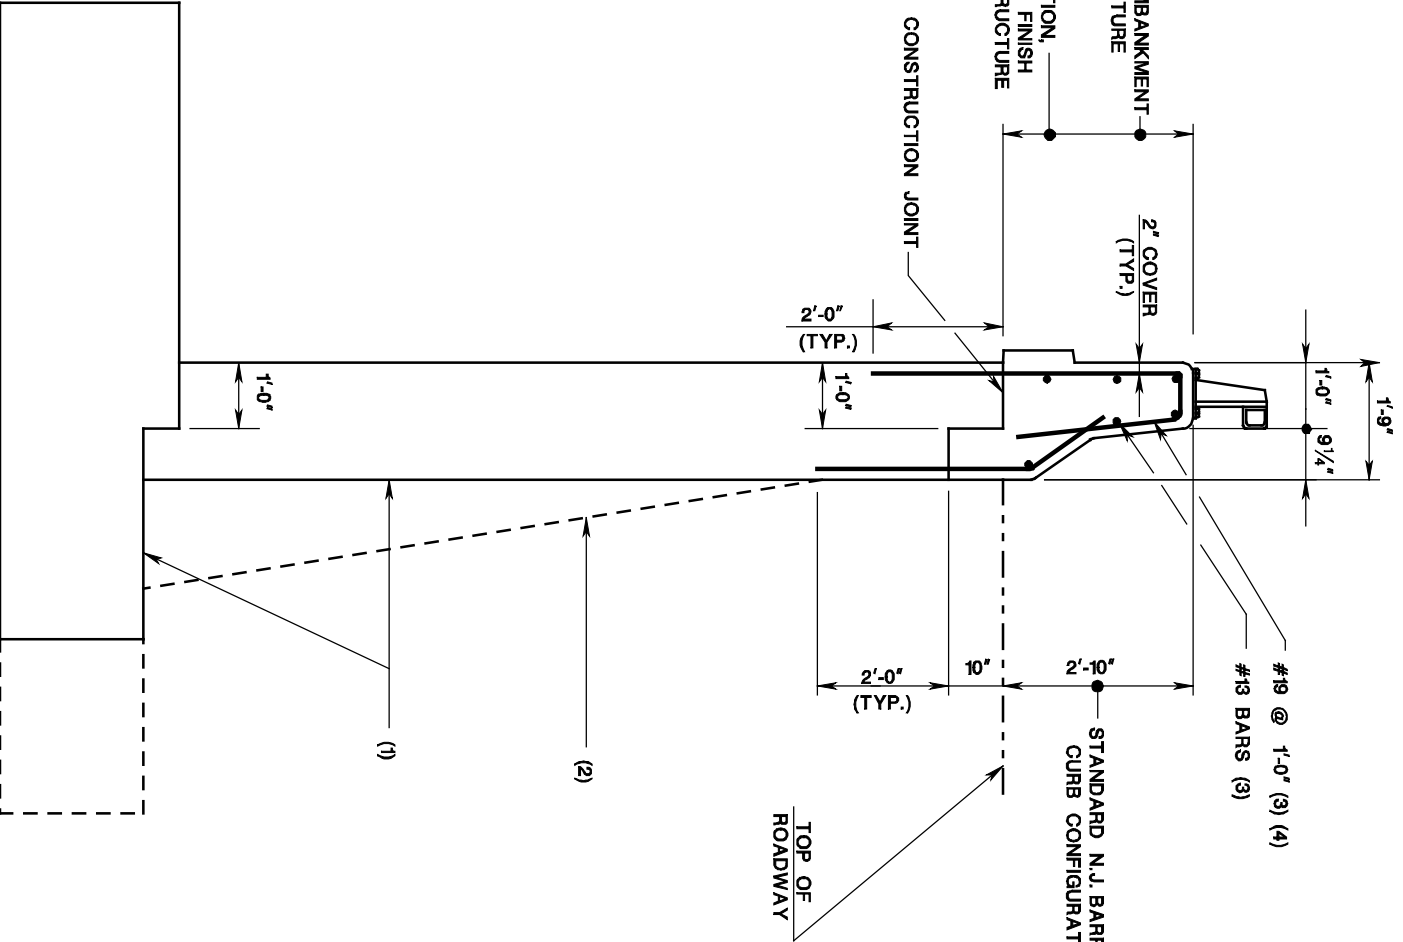

1. SEE PLATE 3.4-1 FOR TYPICAL REINFORCEMENT.
2. DESIGNER SHALL VERIFY THE NEED FOR BATTER FOR WALLS UNDER 10'-0". WALLS OVER 10'-0" SHALL HAVE A MINIMUM BATTER OF 12:1. THE HEIGHT OF THE WALL SHALL BE MEASURED FROM THE TOP OF THE HEEL OF THE FOOTING.
3. CORROSION PROTECTED REINFORCING STEEL.
4. ONE PIECE STIRRUP ARRANGEMENT MAY BE UTILIZED.