
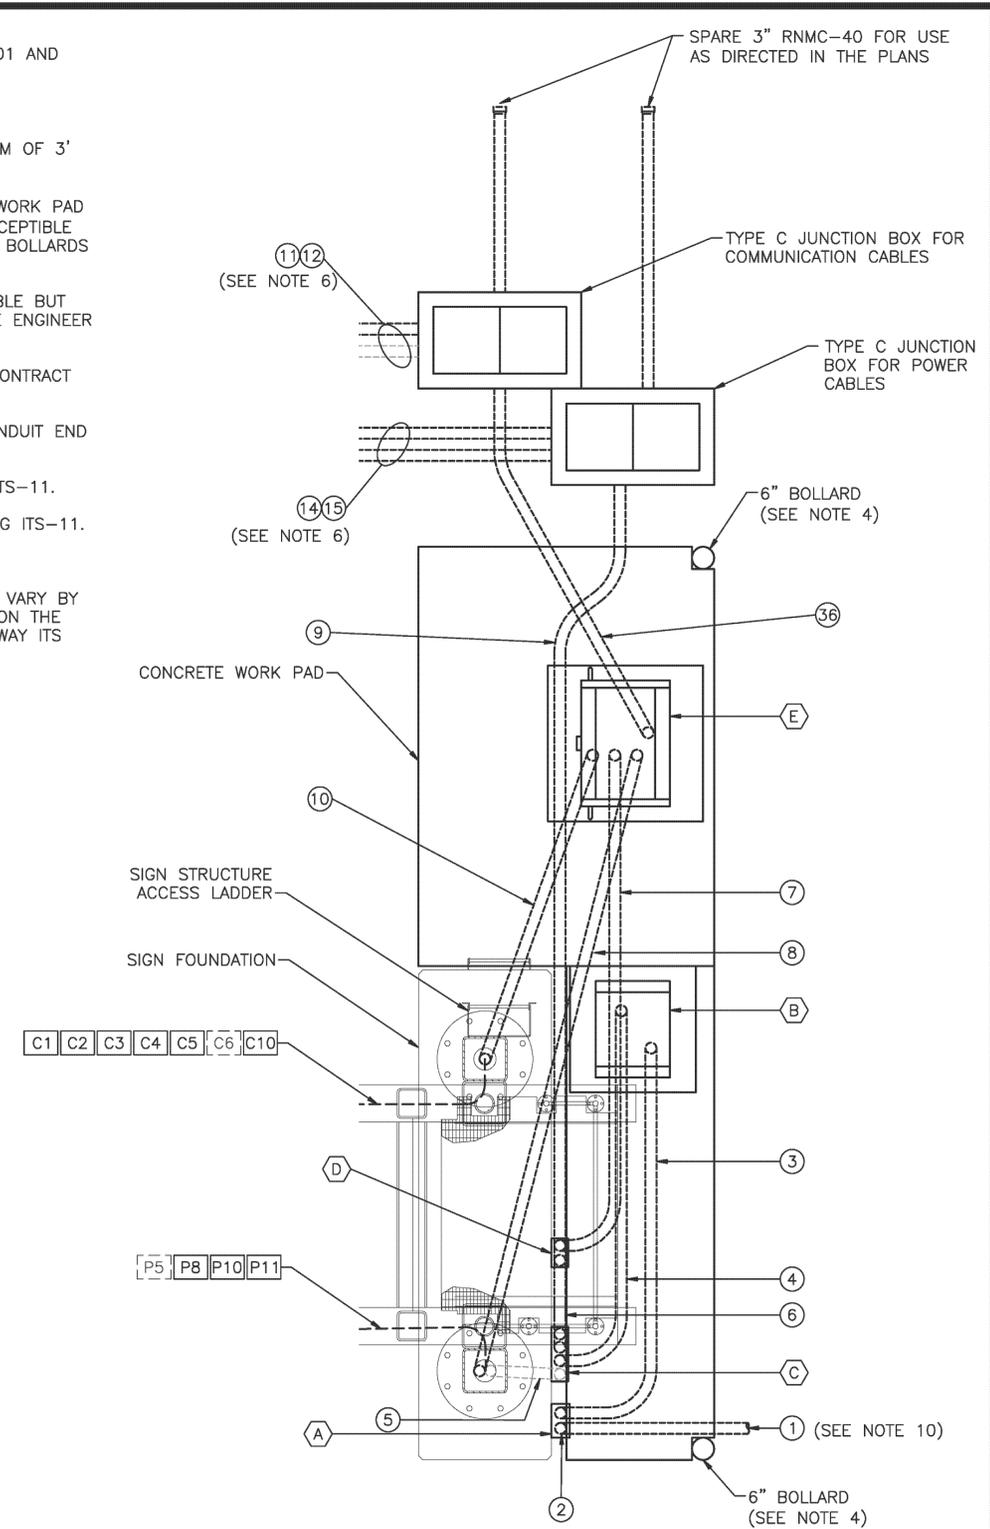


NOTES:

- FOR LEGEND, ABBREVIATIONS, CABLE AND CONDUIT SCHEDULES SEE STANDARD DRAWINGS ITS-01 AND ITS-02.
- FOR INFORMATION ON THE SCC, SEE STANDARD DRAWING ITS-22.
- THE CONCRETE WORK PAD SURROUNDING THE TRANSFORMER AND SCC SHALL EXTEND A MINIMUM OF 3' IN FRONT AND BEHIND THE EQUIPMENT.
- TWO (2) CONCRETE BOLLARDS SHALL BE INSTALLED AT THE TWO CORNERS OF THE CONCRETE WORK PAD FACING AWAY FROM THE ROADWAY (SEE STANDARD DRAWING ITS-11) WHERE EQUIPMENT IS SUSCEPTIBLE TO DAMAGE FROM LAWN MOWERS OR MAINTENANCE EQUIPMENT AND AS SHOWN ON THE PLANS. BOLLARDS NOT SHOWN ON ISOMETRIC DETAIL FOR CLARITY.
- THE ROUTING OF CONDUITS SHOWN ON THIS PLAN SHALL BE FOLLOWED AS CLOSELY AS POSSIBLE BUT ARE DIAGRAMMATIC AND MAY BE MODIFIED TO FIT FIELD CONDITIONS. SUBMIT DEVIATIONS TO THE ENGINEER FOR APPROVAL.
- INSTALLATION OF ITS EQUIPMENT SHOWN ON THIS DRAWING SHALL BE COORDINATED WITH THE CONTRACT PLANS.
- SPARE PULL CORDS SHALL BE INSTALLED IN ALL CONDUITS FOR FUTURE USE BETWEEN ALL CONDUIT END POINTS IN CABINETS, ENCLOSURES, EQUIPMENT, AND JUNCTION BOXES.
- DIMENSIONS OF EQUIPMENT SHOWN ON THIS DRAWING CAN BE FOUND ON STANDARD DRAWING ITS-11.
- FOR INFORMATION ON THE CONSTRUCTION OF THE CONCRETE WORK PAD SEE STANDARD DRAWING ITS-11.
- DIRECTION OF INCOMING SERVICE CABLES WILL VARY, SEE CONTRACT PLANS FOR DETAILS.
- INSTALLATION OF THE UNDERGROUND CONDUITS BETWEEN THE INNER AND OUTER ROADWAY WILL VARY BY LOCATION. SEE CONTRACT PLANS FOR DETAILS. WHERE THESE CONDUITS ARE NOT REQUIRED ON THE CONTRACT PLANS, CABLES SHALL BE ROUTED THROUGH THE SIGN STRUCTURE FOR INNER ROADWAY ITS EQUIPMENT.

OUTER ROADWAY - SCC INSTALLATION ISOMETRIC
SCALE: 1/2" = 1'-0"

	BY	DATE
MADE	EMG	09/2010
TRACED	MDC	09/2010
CHECKED	EMG	09/2010
SUPERVISED	ALB	09/2010



OUTER ROADWAY - SCC INSTALLATION PLAN
SCALE: 1/2" = 1'-0"

NEW JERSEY TURNPIKE AUTHORITY	
NEW JERSEY TURNPIKE	
ITS EQUIPMENT PLATFORM TYPE 2 DETAILS - 1	
HNTB 145 RT. 46 WEST, SUITE 400, WAYNE, NJ 07470 - CO.# 24GA2800700 ANTHONY L. BARTELLO <small>New Jersey Professional Engineer License No. GE 48842</small>	
STANDARD DRAWING ITS-10	

APP. NO.	DATE	REVISION
0	09/2010	ORIGINAL DRAWING