
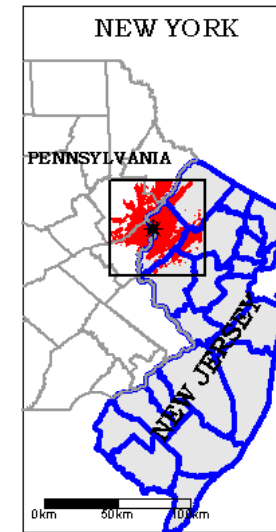


Handout #2

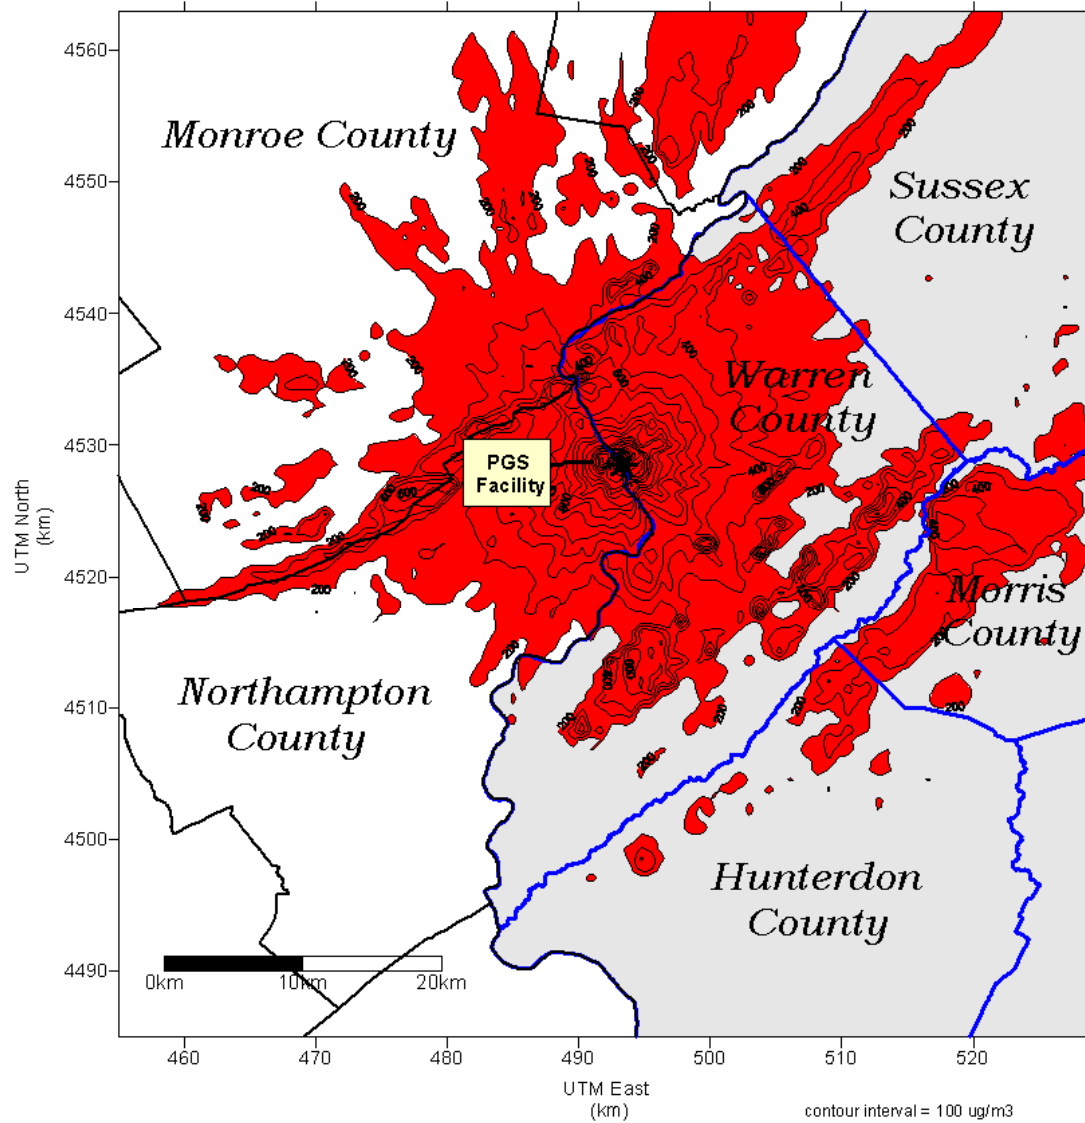

1-Hour SO₂ NAAQS of 196 ug/m³

SO₂ 1-hr 99th Percentile impacts at each receptor (ug/m³)

■ Represents predicted violations of the primary 1-hr SO₂ NAAQS

Minimum Contour = 200 ug/m³

Contour Interval = 100 ug/m³

2003 Meteorology

No Background Air Quality Data Included

CALPUFF Predicted Violations of the 1-Hour Sulfur Dioxide NAAQS (99th Percentile) Due to Allowable Emissions from the Portland Power Plant